


# 200350 and 200355 Accelerometers

Bently Nevada\* Asset Condition Monitoring

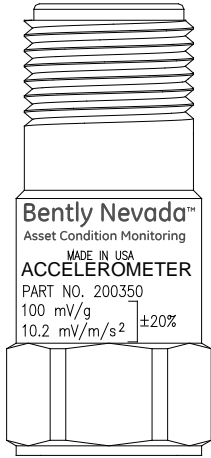

## Description

The 200350 and 200355 Accelerometers are general purpose, case-mounted seismic transducers designed for use with Trendmaster\* Pro Constant Current Direct Input Card 149811-02 and the Seismic Direct Input Card 164746-01.

The 200350 and 200355 Accelerometers are contained within a hermetically sealed, stainless steel case. The design provides an extremely rugged transducer, well suited for harsh industrial environments. Each transducer's top mounted, 2-pin connector (MIL-C-5015) allows for easy installation and removal of the interconnecting signal cable. A ¼-28 threaded hole on the bottom of the casing accommodates multiple mounting options.

The 200350 and 200355 Accelerometers contain a piezoelectric sensing device, which generates charge when subjected to vibration. This charge is then converted electronically to a differential voltage signal, which is proportional to the acceleration that is parallel to the sensitive axis of the transducer.



## Application Alert

If housing measurements are being made for overall protection of the machine, consider the usefulness of the measurement for each application. Most common machine malfunctions (imbalance, misalignment, etc.) originate at the rotor and cause an increase (or at least a change) in rotor vibration. For housing measurements alone to be effective for overall machine protection, a significant amount of rotor vibration must be faithfully transmitted to the bearing housing or machine casing, or more specifically, to the mounting location of the transducer.

In addition, exercise care in the physical installation of the transducer. Improper installation can result in a degradation of the transducer's performance and/or the generation of signals that do not represent actual machine vibration. Upon request, we can provide engineering services to determine the suitability of housing measurements for the machine in question and/or to provide installation



Specifications and Ordering Information  
Part Number 164804-01  
Rev. H (06/14)

Page 1 of 10

## Specifications

Parameters are specified from +20 to +30 °C (+68 to +86 °F) and 100 Hz unless otherwise indicated.



### Application Alert

Operation outside the specified limits will result in false readings or loss of machine monitoring.

### Electrical

	200350	200355
<b>Sensitivity</b>	100 mV/g ±20% (1.2 mV/g ±20%)	100 mV/g ±5% (1.2 mV/g ±5%)
<b>Frequency Range (±3 dB)</b>	30-600,000 cpm (0.5-10,000 Hz)	12-600,000 cpm (0.2-10,000 Hz)
<b>Measurement Range</b>	± 50 g	
<b>Transverse Sensitivity</b>	≤ 7%	≤ 5%
<b>Amplitude Linearity</b>	± 1%	
<b>Mounted Resonant Frequency</b>	1500 kcpm (25 kHz)	1250 kcpm (20.8 kHz)
<b>Broadband Electrical Noise (1-10kHz)</b>	350 µg (3,434 µm/s <sup>2</sup> )	50 µg (491 µm/s <sup>2</sup> )
<b>Output Bias Voltage</b>	8 to 12 VDC	
<b>Excitation Voltage</b>	18 to 28 VDC	
<b>Constant Current Excitation</b>	2 to 20 mA	
<b>Settling Time (within 1% of bias)</b>	≤ 2.0 sec	≤ 5.0 sec
<b>Output Impedance</b>	< 150 ohms	< 100 ohms
<b>Discharge Time Constant</b>	≥ 0.3 sec	≥ 0.8 sec
<b>Electrical Isolation (Case)</b>	> 10 <sup>8</sup> ohms	

### Environmental

<b>Operating Temperature Range</b>	-65 to +250 °F (-54 to +121 °C)
<b>Shock Survivability</b>	5,000 g pk
<b>Relative Humidity</b>	100% relative, condensing, non-submerged
<b>Enclosure Rating</b>	IP68

### Physical

	200350	200355
<b>Hex Size</b>	11/16" (18 mm)	7/8" (22mm)
<b>Height</b>	1.65" (42.4 mm)	2.06" (52.3 mm)
<b>Weight</b>	1.8 oz (51 grams)	3.3 oz (94 grams)
<b>Mounting Thread</b>	1/4-28 Female	
<b>Mounting Torque (Maximum)</b>	2 to 5 ft-lb (2.7 to 6.8 N-m)	
<b>Sensing Element</b>	Ceramic	
<b>Sensing Geometry</b>	Shear	
<b>Housing Material</b>	Stainless Steel	
<b>Sealing</b>	Welded Hermetic	
<b>Electrical Connector</b>	2-Pin Mil-C-5015	
<b>Electrical Connection Position</b>	Top	

---

## Hazardous Area Approvals

### 200350


#### North America


Ex ia / AEx ia IIC T4  
Class I, Div 1 Groups A, B, C & D  
When installed per dwg 175825  
T4 @ -54 °C ≤ Ta ≤ 121 °C

Ex nL/AEx nA IIC T4  
Class I, Div 2 Groups A, B, C & D  
When installed per dwg 175825  
T4 @ -54 °C ≤ Ta ≤ 121 °C

CSA 2007 1971585

#### ATEX

 II 1 G  
Ex ia IIC T4 Ga  
T4 @ -54 °C ≤ Ta ≤ 121 °C

 II 3 G  
Ex nA IIC T4 Gc  
T4 @ -54 °C ≤ Ta ≤ 121 °C

#### International

IECEX LCIE 13.0070X  
Ex ia IIC T4 Ga  
Ex nA IIC T4 Gc  
T4 @ -54 °C ≤ Ta ≤ +121 °C

### 200355

The 200355 accelerometer does not have hazardous area approvals at this time.

For further certification and approvals information please visit

<http://www.ge-mcs.com/en/bently-nevada.html>

---

## EMC Directive (CE Mark)

Standards to which conformity is declared:

CISPR 11 / EN 55011	Emissions: Class B, Group 1
EN61326 / A1	Emissions: Industrial Location
EN61326 / A1	Immunity: Industrial Location

---

## Accessories

### 200350 and 200355 Accelerometer Manual

168303-01

### Trendmaster\* Pro System Manual

162411

### Trendmaster DSM Datasheet

149831-01

### Trendmaster DSM Manual

149823-01

---

## Mounting Studs

Dimensional diagrams of all available mounting studs are shown in Figure 8.

### ¼-28 Mounting Stud

164373

### M6x1 Mounting Stud

164372

### M8X1.25 Mounting Stud

167559

---

### Adhesive Mounting Kits

Adhesive studs are sold in kits containing two threaded studs and two mounting pads. Also in the kit is a packet of acrylic adhesive and materials to mix its two components. A scouring pad and alcohol wipe are provided for preparing the mounting surface.

Temperature Range: -67 to +250 °F (-55 to 121 °C)  
Cure Time: 24 hours



### Application Alert

Use of adhesive will attenuate high frequency components that may be present.

#### ***¼-28 Adhesive Mounting Kit***

167563-10

#### ***M6x1 Adhesive Mounting Kit***

167563-11

#### ***M8X1.25 Adhesive Mounting Kit***

167563-12

---

### Magnetic Base Kit

The magnetic base is has a pull of 35 lbf and it is suitable for placement on both curved surfaces and flat surfaces. The magnet comes supplied with a ¼-28 mounting stud. A dimensional diagram of the magnetic base is shown in Figure 9.

#### ***Magnetic Base w/ Mounting Stud***

286244

---

### Cables

The Splash proof cable is not recommended for the model 200350 accelerometer.

The standard cables are 22 AWG 2-conductor twisted shielded pairs with 2-socket moisture-resistant female connector at one end, terminal lugs at the other end. Cable length is optional and comes in increments of 1 ft between the stated maximum and minimum lengths.

#### ***Splash Proof Cable***

CB2W100 – AXXX

A: Length

**0 1 5** 15 ft

**0 3 2** 32 ft

**0 6 4** 64 ft

**1 1 2** 112 ft

**1 2 5** 125 ft

**1 5 0** 150 ft

**2 0 0** 200 ft

**2 5 0** 250 ft

#### ***Standard Cable, No Armor***

9571 – AXX

A: Length

**0 2** Minimum length, 2 ft

**9 9** Maximum length, 99 ft

**x x** Desired length in ft

#### ***Standard Cable, Armored***

84661 – AXX

A: Length

**0 3** Minimum length, 3 ft

**9 9** Maximum length, 99 ft

**x x** Desired length in ft

---

## Ordering Information

---

### 200350 Accelerometer

#### 200350 – AXX – BXX - CXX

##### A: Mounting Stud

00	¼-28 SS w/ Brass tip, 0.5"
01	¼-28 to M6 x 1.00 BeCu
02	¼-28 to M8 x 1.25 BeCu
09	No mounting stud
10	¼-28 Adhesive Stud Mount
11	M6x1 Adhesive Stud Mount
12	M8x1.25 Adhesive Stud Mount
13	Magnetic Base Kit

##### B: Tolerance

00	100 mV/g ± 20%
----	----------------

##### C: Approvals

00	No approvals
01	Multi Approvals (North America, ATEX)

---

### 200355 Accelerometer

#### 200355 – AXX – BXX - CXX

##### A: Mounting Stud

00	¼-28 SS w/ Brass tip, 0.5"
01	¼-28 to M6 x 1.00 BeCu
02	¼-28 to M8 x 1.25 BeCu
09	No mounting stud
10	¼-28 Adhesive Stud Mount
11	M6x1 Adhesive Stud Mount
12	M8x1.25 Adhesive Stud Mount
13	Magnetic Base Kit


##### B: Tolerance

00	100 mV/g ± 5%
----	---------------

##### C: Approvals


00	No approvals
----	--------------

# Graphs and Figures

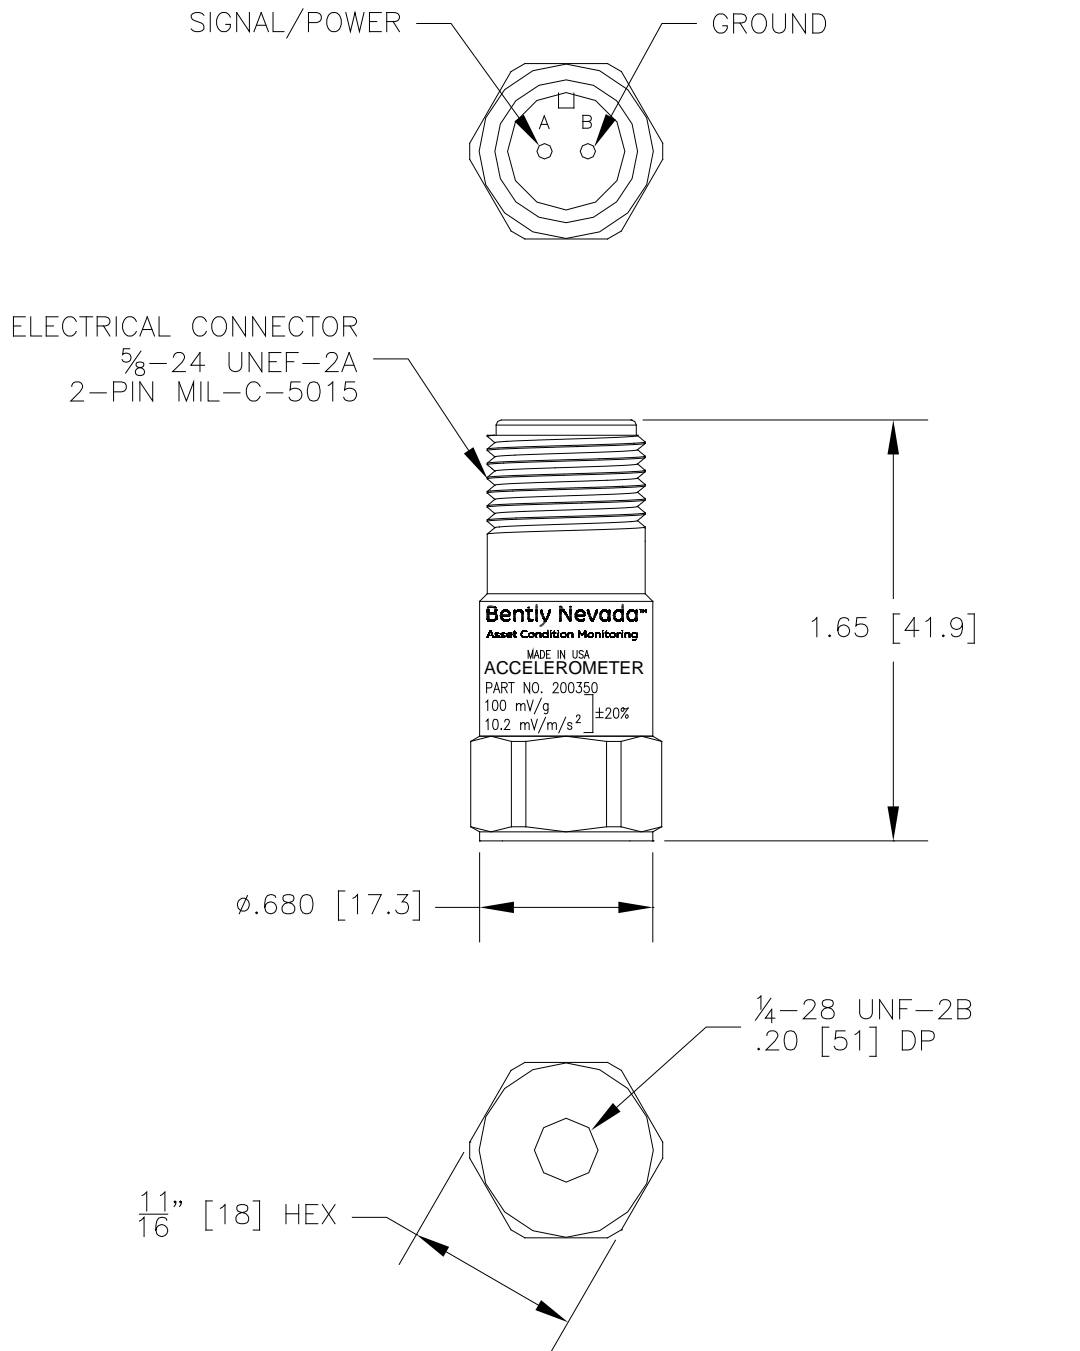

DIMENSIONS UNITS: in [mm]

**Figure 1. 200350 Accelerometer Dimensional Drawing**

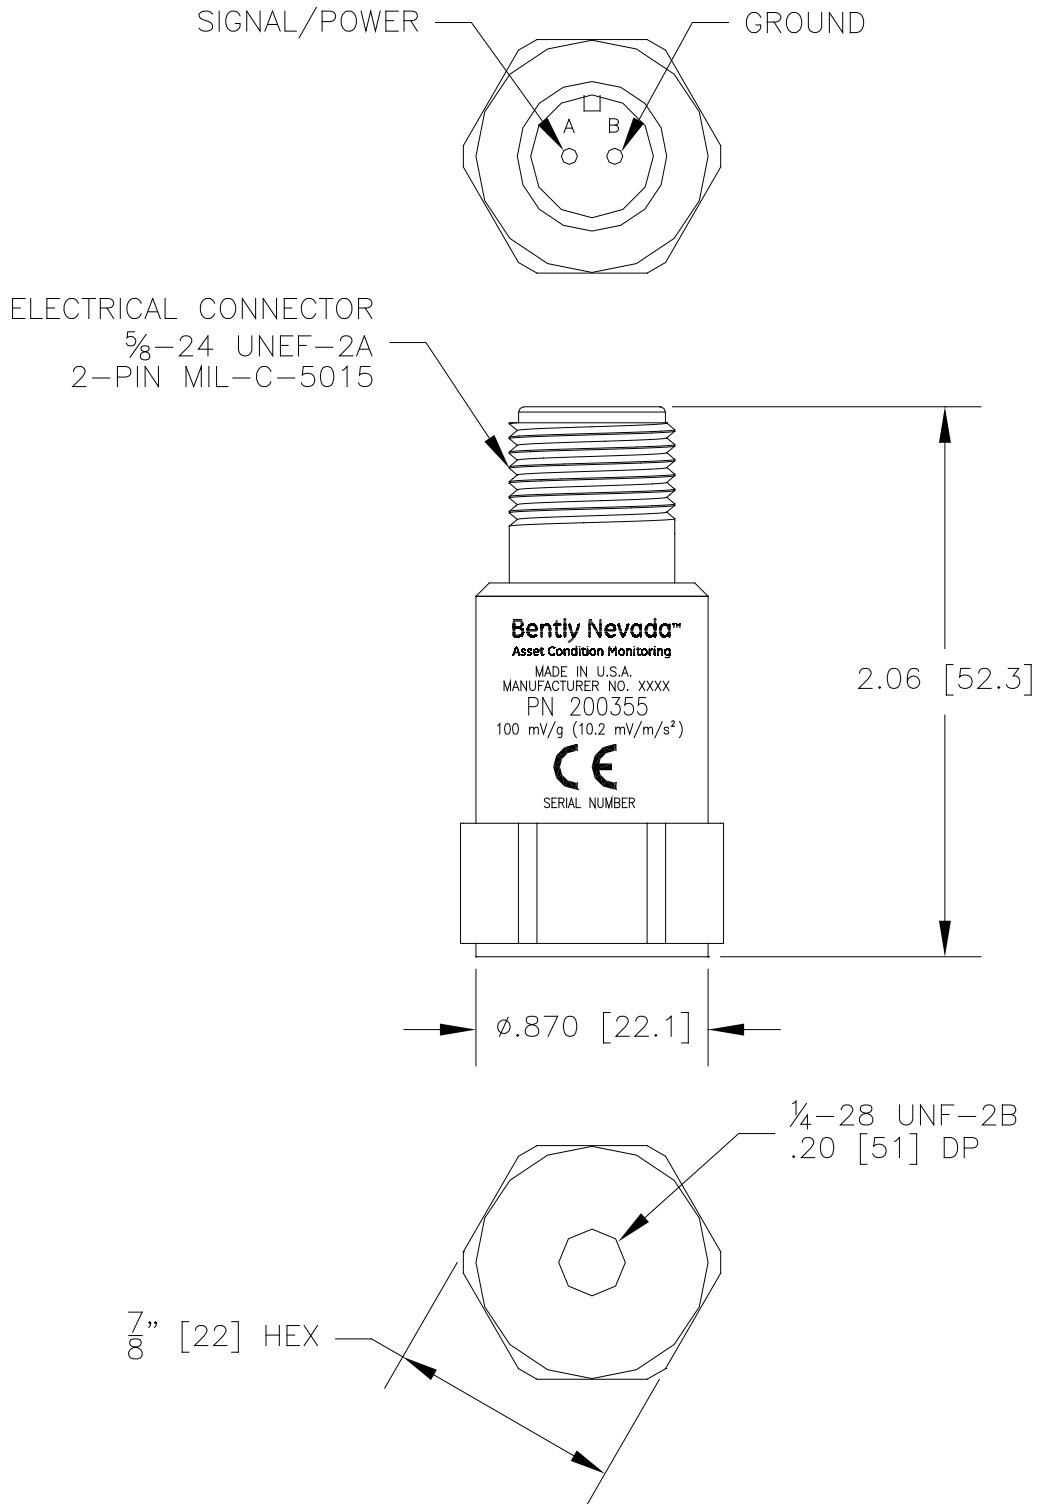

DIMENSIONS UNITS: in [mm]

Figure 2. 200355 Accelerometer Dimensional Drawing

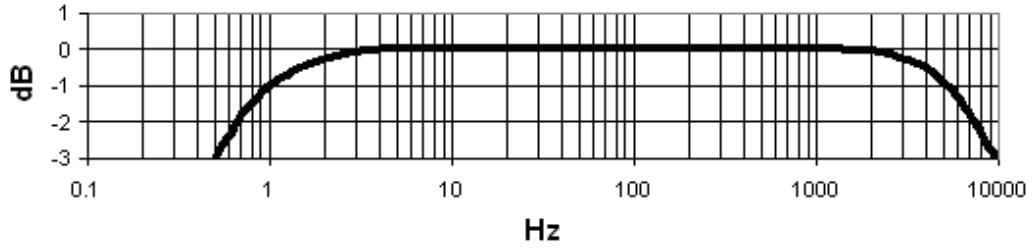


Figure 3. 200350 Accelerometer Frequency Response

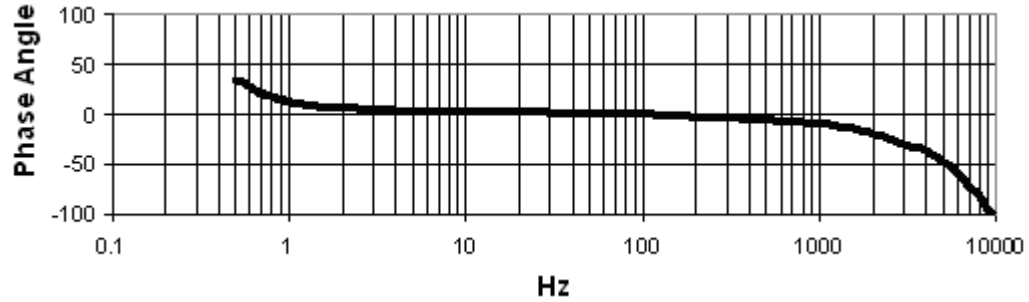


Figure 4. 200350 Accelerometer Phase

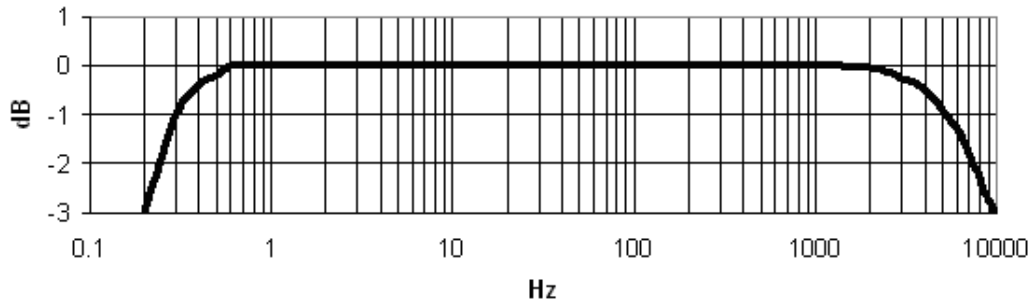


Figure 5. 200355 Accelerometer Frequency Response

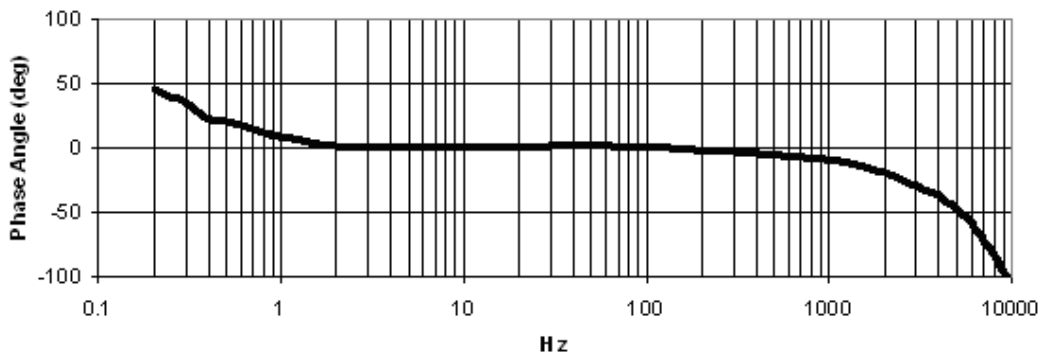


Figure 6. 200355 Accelerometer Phase



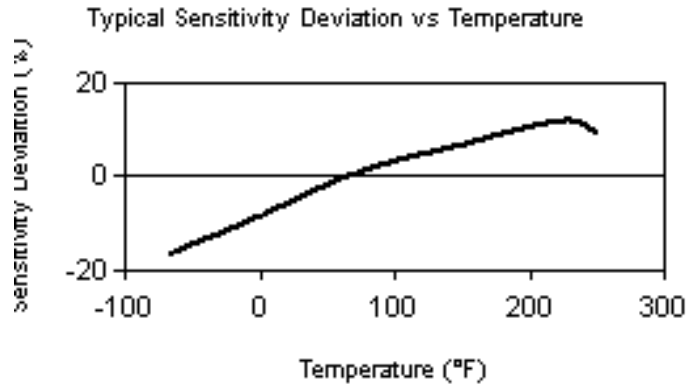


Figure 7. Temperature Sensitivity Curve

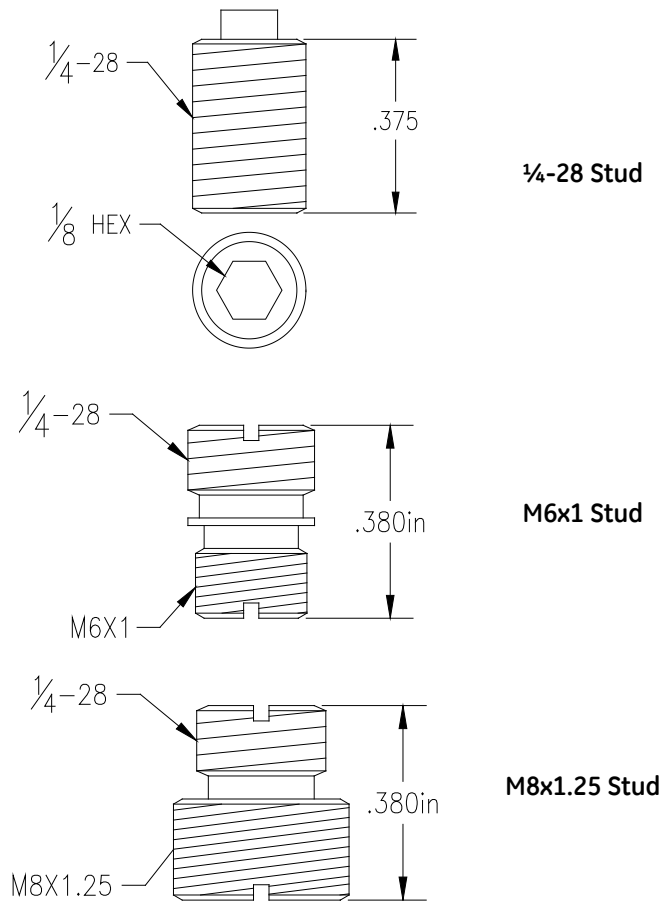
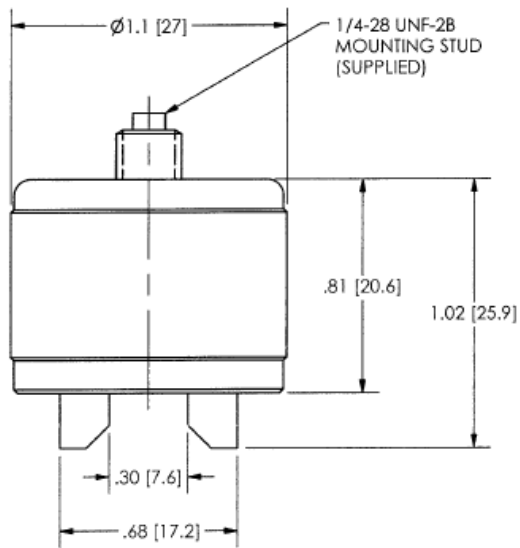


Figure 8. Mounting Stud Dimensional Drawings



**Figure 9. Magnetic Base Dimensional Drawing**

\* Denotes a trademark of Bently Nevada, Inc., a wholly owned subsidiary of General Electric Company.

© 2003-2014 Bently Nevada, Inc. All rights reserved.

Printed in USA. Uncontrolled when transmitted electronically.

1631 Bently Parkway South, Minden, Nevada USA 89423

Phone: 775.782.3611 Fax: 775.215.2873

<http://www.ge-mcs.com/en/bently-nevada.html>